


This Detail Drawing may not be altered or changed in any manner except by the City Engineer. It is the responsibility of the user to acquire the most current version.

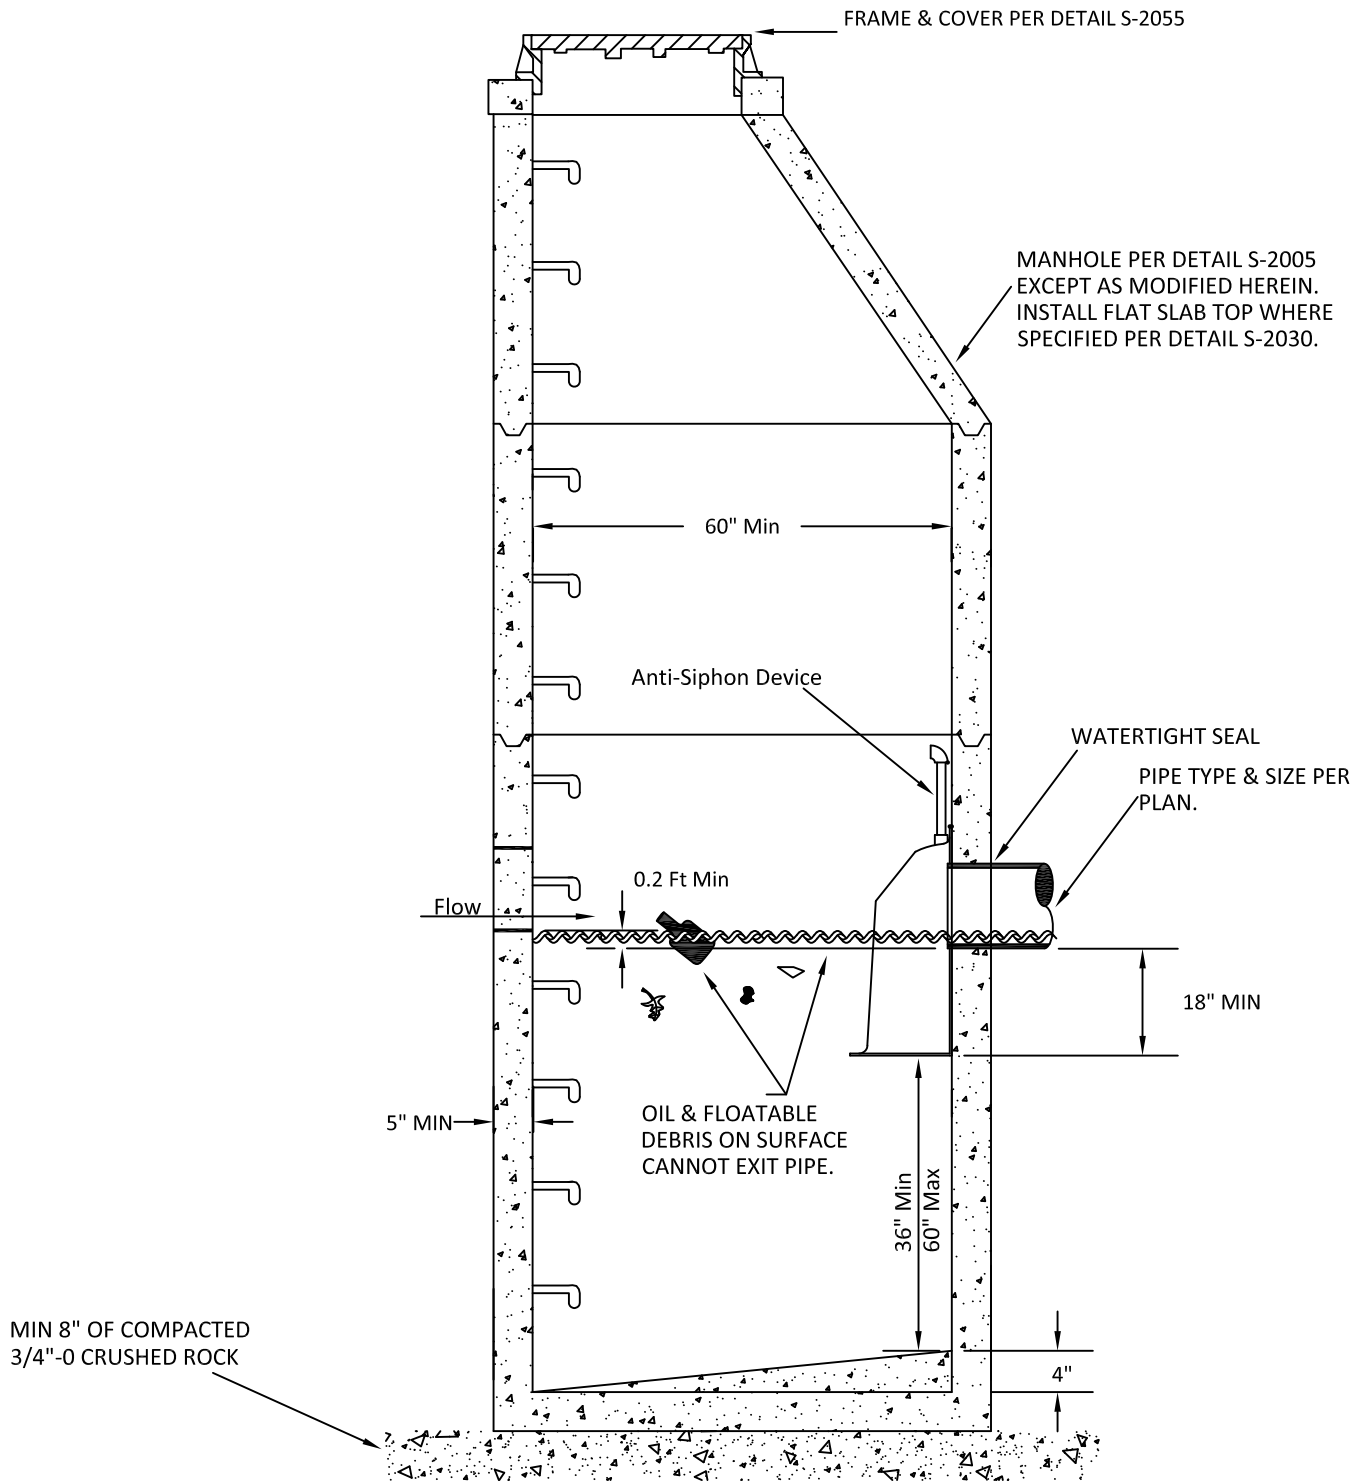

NOTES:

1. ALL PRECAST SECTIONS SHALL CONFORM TO THE REQUIREMENTS OF A.S.T.M. C-478.
2. MANHOLE DIAMETER TO BE DETERMINED BY SIZE OF OUTLET PIPE. 12"-21" PIPE = 60" DIAMETER MANHOLE. 24"+ PIPE, MANHOLE DIAMETER TO BE DESIGNED. MAX. SUMP DEPTH 5'.
3. POUR BOTTOM TO SLOPE TO STEPS.
4. ALL HOODS AND TRAPS FOR CATCH BASINS AND WATER QUALITY STRUCTURES SHALL BE AS MANUFACTURED BY: BEST MANAGEMENT PRODUCTS, INC. (860)434-0277, (860)434-3195 FAX TOLL FREE (800)504-8008 OR (888)354-7585 WWW.BESTMP.COM OR PRE-APPROVED EQUAL, SEE DETAIL S-2051

Stormwater Pretreatment Manhole

**CITY OF
WILSONVILLE**



DRAWING NUMBER: S-2050

DRAWN BY: SR

SCALE: N.T.S.

FILE NAME: S-2050.DWG

APPROVED BY: NK

DATE: 6/4/14

PUBLIC WORKS STANDARDS