

This Detail Drawing may not be altered or changed in any manner except by the City Engineer. It is the responsibility of the user to acquire the most current version.

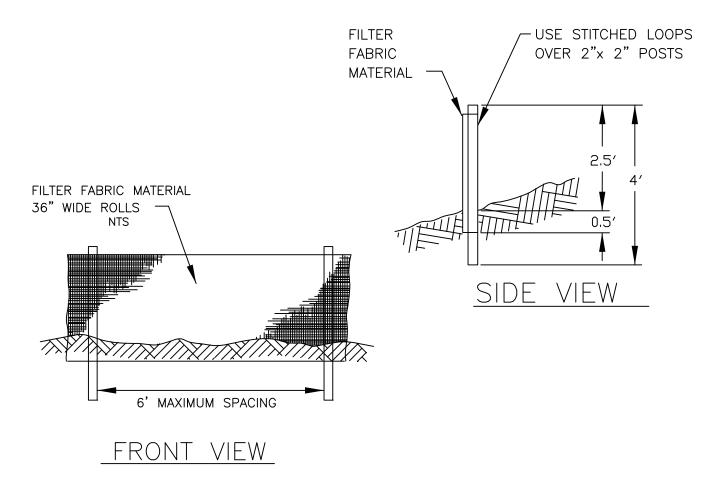

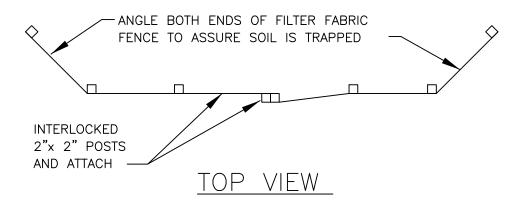

NOTE:

- 1. SEDIMENT FENCING SHALL BE INSTALLED AS PER MANUFACTURER RECOMMENDATIONS.
- 2. BURY BOTTOM OF FILTER FABRIC 6" MIN. VERTICALLY BELOW GRADE.
- 3. 2" X 2" FIR, PINE, OR STEEL FENCE POSTS.
- 4. STITCHED LOOPS TO BE INSTALLED UPHILL SIDE OF SLOPE.
- 5. COMPACT NATIVE FILL IN ALL AREAS OF FILTER FABRIC TRENCH.

| Sediment Fence | | | CITY OF | |
|------------------------|-----------------|---------------|------------------------|----|
| DRAWING NUMBER: S-2245 | DRAWN BY: SR | SCALE: N.T.S. | WILSONVILLE | ₩₩ |
| FILE NAME: S-2245.DWG | APPROVED BY: NK | DATE: 9/17/14 | PUBLIC WORKS STANDARDS | |