


This Detail Drawing may not be altered or changed in any manner except by the City Engineer. It is the responsibility of the user to acquire the most current version.

FILE NAME: WT-3110.DWG
 DRAWING NUMBER: WT-3110
 APPROVED BY: PN
 DATE: 3/13/19

DRAWN BY: ST
 SCALE: N.T.S.

3" & Larger Magnetic Meter

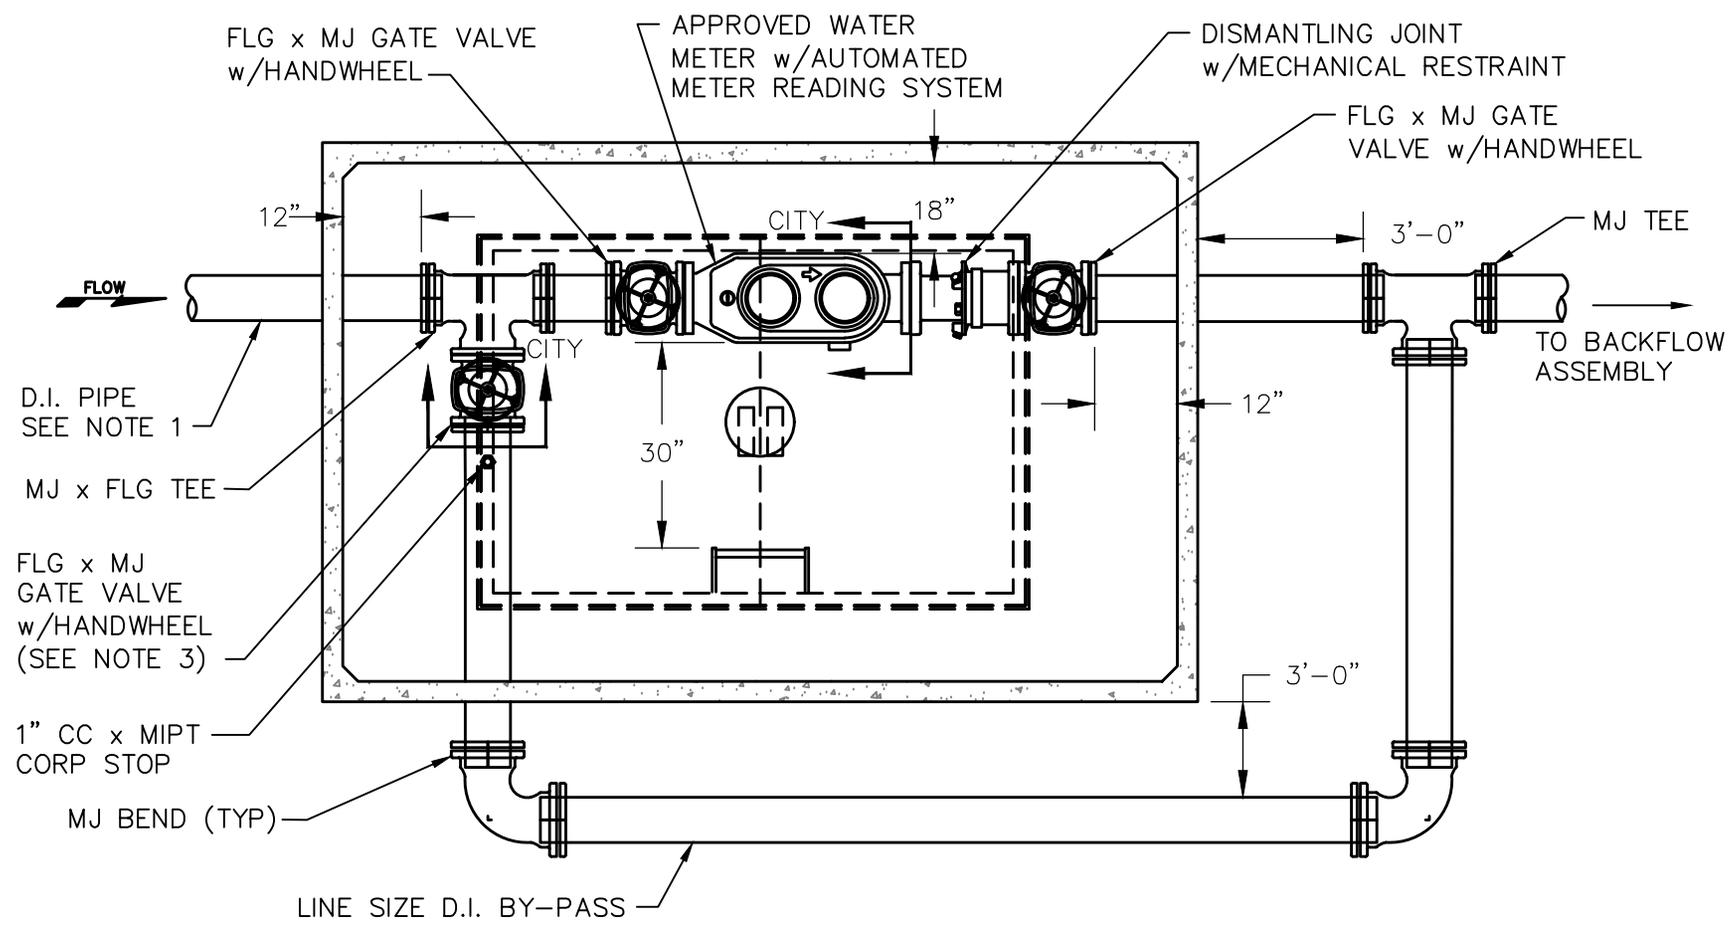

NOTES:

1. ALL PIPE AND FITTINGS SHALL MATCH METER SIZE UNLESS OTHERWISE SPECIFIED.
2. BY-PASS PIPE AND FITTINGS SHALL BE SAME SIZE AS METER UNLESS OTHERWISE APPROVED BY CITY'S AUTHORIZED REPRESENTATIVE.
3. WATER DEPT SHALL INSTALL CHAIN & LOCK ON BYPASS HANDWHEEL TO PREVENT TAMPERING.
4. INSTALL STANDARD COMPOUND METER ASSEMBLY IN ACCORDANCE WITH DETAIL WT-3115.
5. FOR USE IN NON-TRAFFIC AREAS ONLY. HATCH DOORS SHALL INCLUDE DRAIN CHANNEL AND 1-1/2" DRAIN COUPLER. USE NON-SLIP FINISH IN AREAS WITH PEDESTRIAN OR BIKE FACILITIES.

<u>3" METER</u>	OLDCASTLE VAULT NO. 575-LA	DOOR NO. 57-T-2-332P	SEE NOTE 5?
<u>4" METER</u>	OLDCASTLE VAULT NO. 687-WA	DOOR NO. USF: THD-4872	SEE NOTE 5
<u>6" METER</u>	OLDCASTLE VAULT NO. 687-WA	DOOR NO. USF: THD-4872	SEE NOTE 5
<u>8" METER</u>	OLDCASTLE VAULT NO.810-WA	DOOR NO. USF: THD-4872	SEE NOTE 5
<u>10" METER</u>	OLDCASTLE VAULT NO.810-WA	DOOR NO. USF: THD-4872	SEE NOTE 5

CITY OF WILSONVILLE
 PUBLIC WORKS STANDARDS

